


G:\LANL Engineering Standards\Eng. Manual [LEW]\2. Approved\ST-G3010-4C111.dwg, 09/03/02 @ 10:43 03/06/99

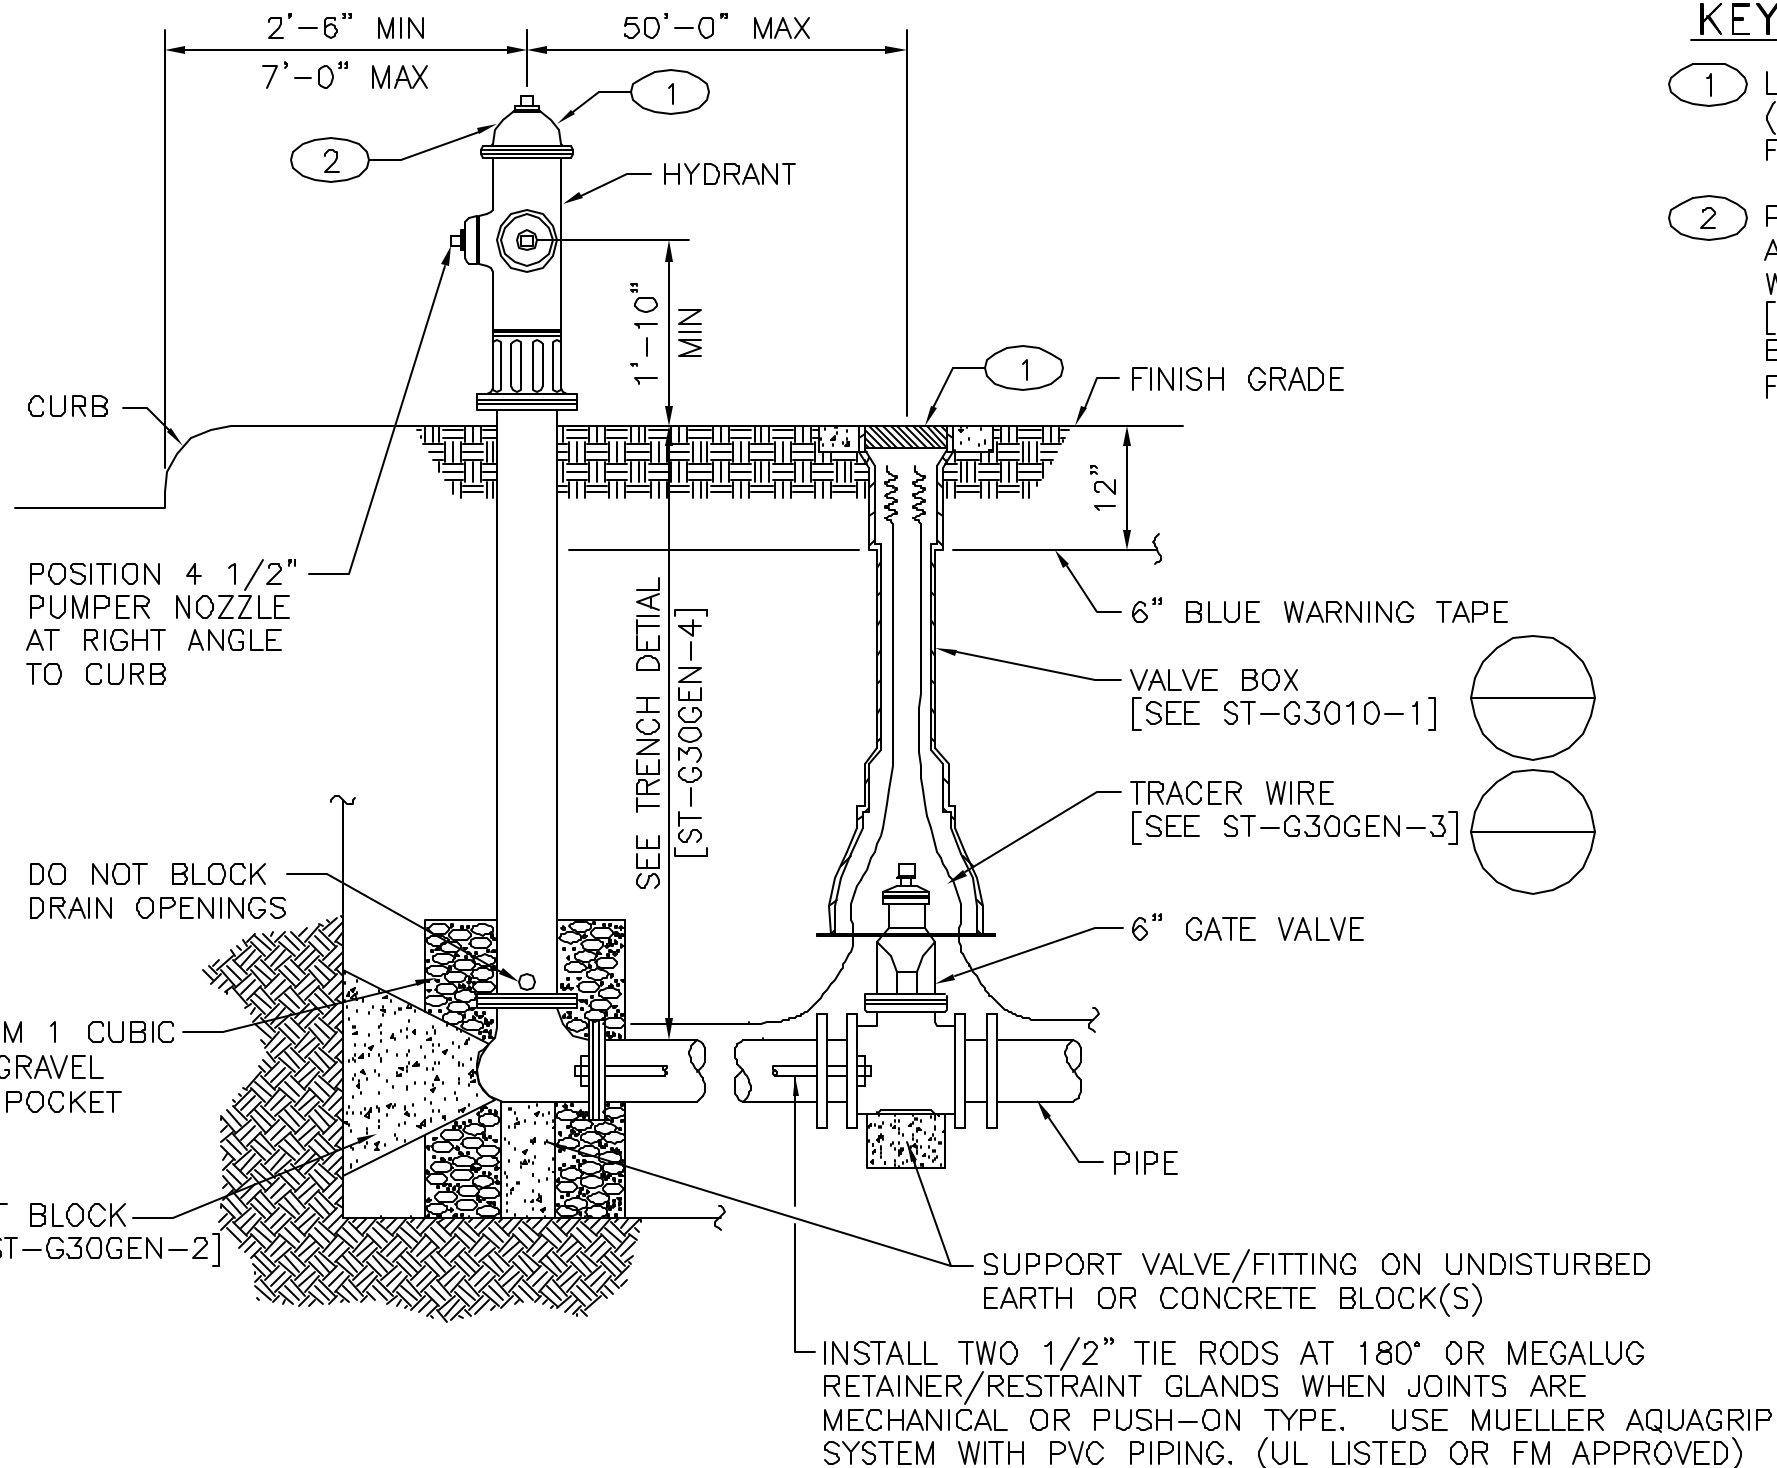

FIRE HYDRANT DETAIL

SCALE: NONE

NOTES FOR DESIGNER: (DO NOT INCLUDE ON CONSTRUCTION DRAWINGS)

1. SEE SHEET 2.

KEYED NOTES:

- 1 LANL SUPPORT SERVICES SUBCONTRACTOR (SSS) WILL NUMBER (METAL STAMP) THE FIRE HYDRANT AND VALVE BOX LID.
- 2 PAINT HYDRANT BONNET BLACK AND ATTACH LABEL - CAUTION: NON-POTABLE WATER, DO NOT DRINK. [REQUIRED ONLY FOR HYDRANTS SERVED BY NON-POTABLE WATER ON DEDICATED FIRE LOOPS.]

DRAWING DEVELOPED FOR ML-3 PROJECTS. FOR ML-1/ML-2, ADDITIONAL REQUIREMENTS AND QA REVIEWS ARE REQUIRED. (REMOVE THIS NOTE WHEN INSERTED INTO A DRAWING PACKAGE).

1	8/23/02	U	GENERAL REVISION AND DWD. NO. WAS STG110.	RP	EH	MS	EH	TO	
NO	DATE	CLASS	REV	DESCRIPTION	OWN	VER	CHKD	SUB	APP
FACILITY & WASTE OPERATIONS SYSTEMS ENGINEERING & MAINTENANCE									
LANL ENGINEERING MANUAL					DRAWN	R. PEARSON			
FIRE HYDRANT GATE SHUT-OFF VALVE DETAIL					DESIGN	E. HOTH			
BLDG. X					CHECKED	M. SMITHDUR			
SUBMITTED					DATE	11-28-99			
DISCIPLINE POC: E. HOTH					APPROVED FOR RELEASE	STANDARDS MANAGER: TOBIN GRUCH			
Los Alamos NATIONAL LABORATORY					SHEET	1			
PO Box 1663 Los Alamos, New Mexico 87545					1	OF 2			
CLASSIFICATION U					REVIEWER	LARRY BAYS		DATE	REV
PROJECT ID					DRAWING NO	CHAPTER 3		ST-G3010-4	1